

Option C: Vint Hill

- New Overhead Line from Wheeler-Vint Hill
- Wreck and Rebuild Existing Remington CT – Warrenton line for Double Circuit
- Convert Wheeler - Gainesville to 230 kV
- Substation expansion at Warrenton, add switching station at Wheeler and Vint Hill


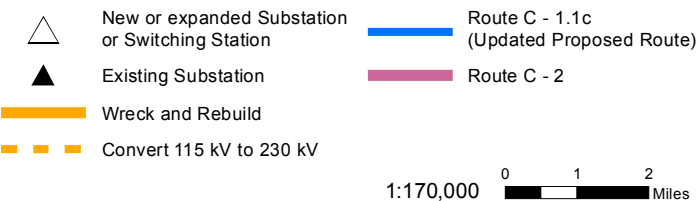


Figure 1-3
Option C
Remington - Warrenton 230 kV Double Circuit Line
Vint Hill - Wheeler and Wheeler - Gainesville 230 kV
Transmission Lines
Fauquier and Prince William Counties

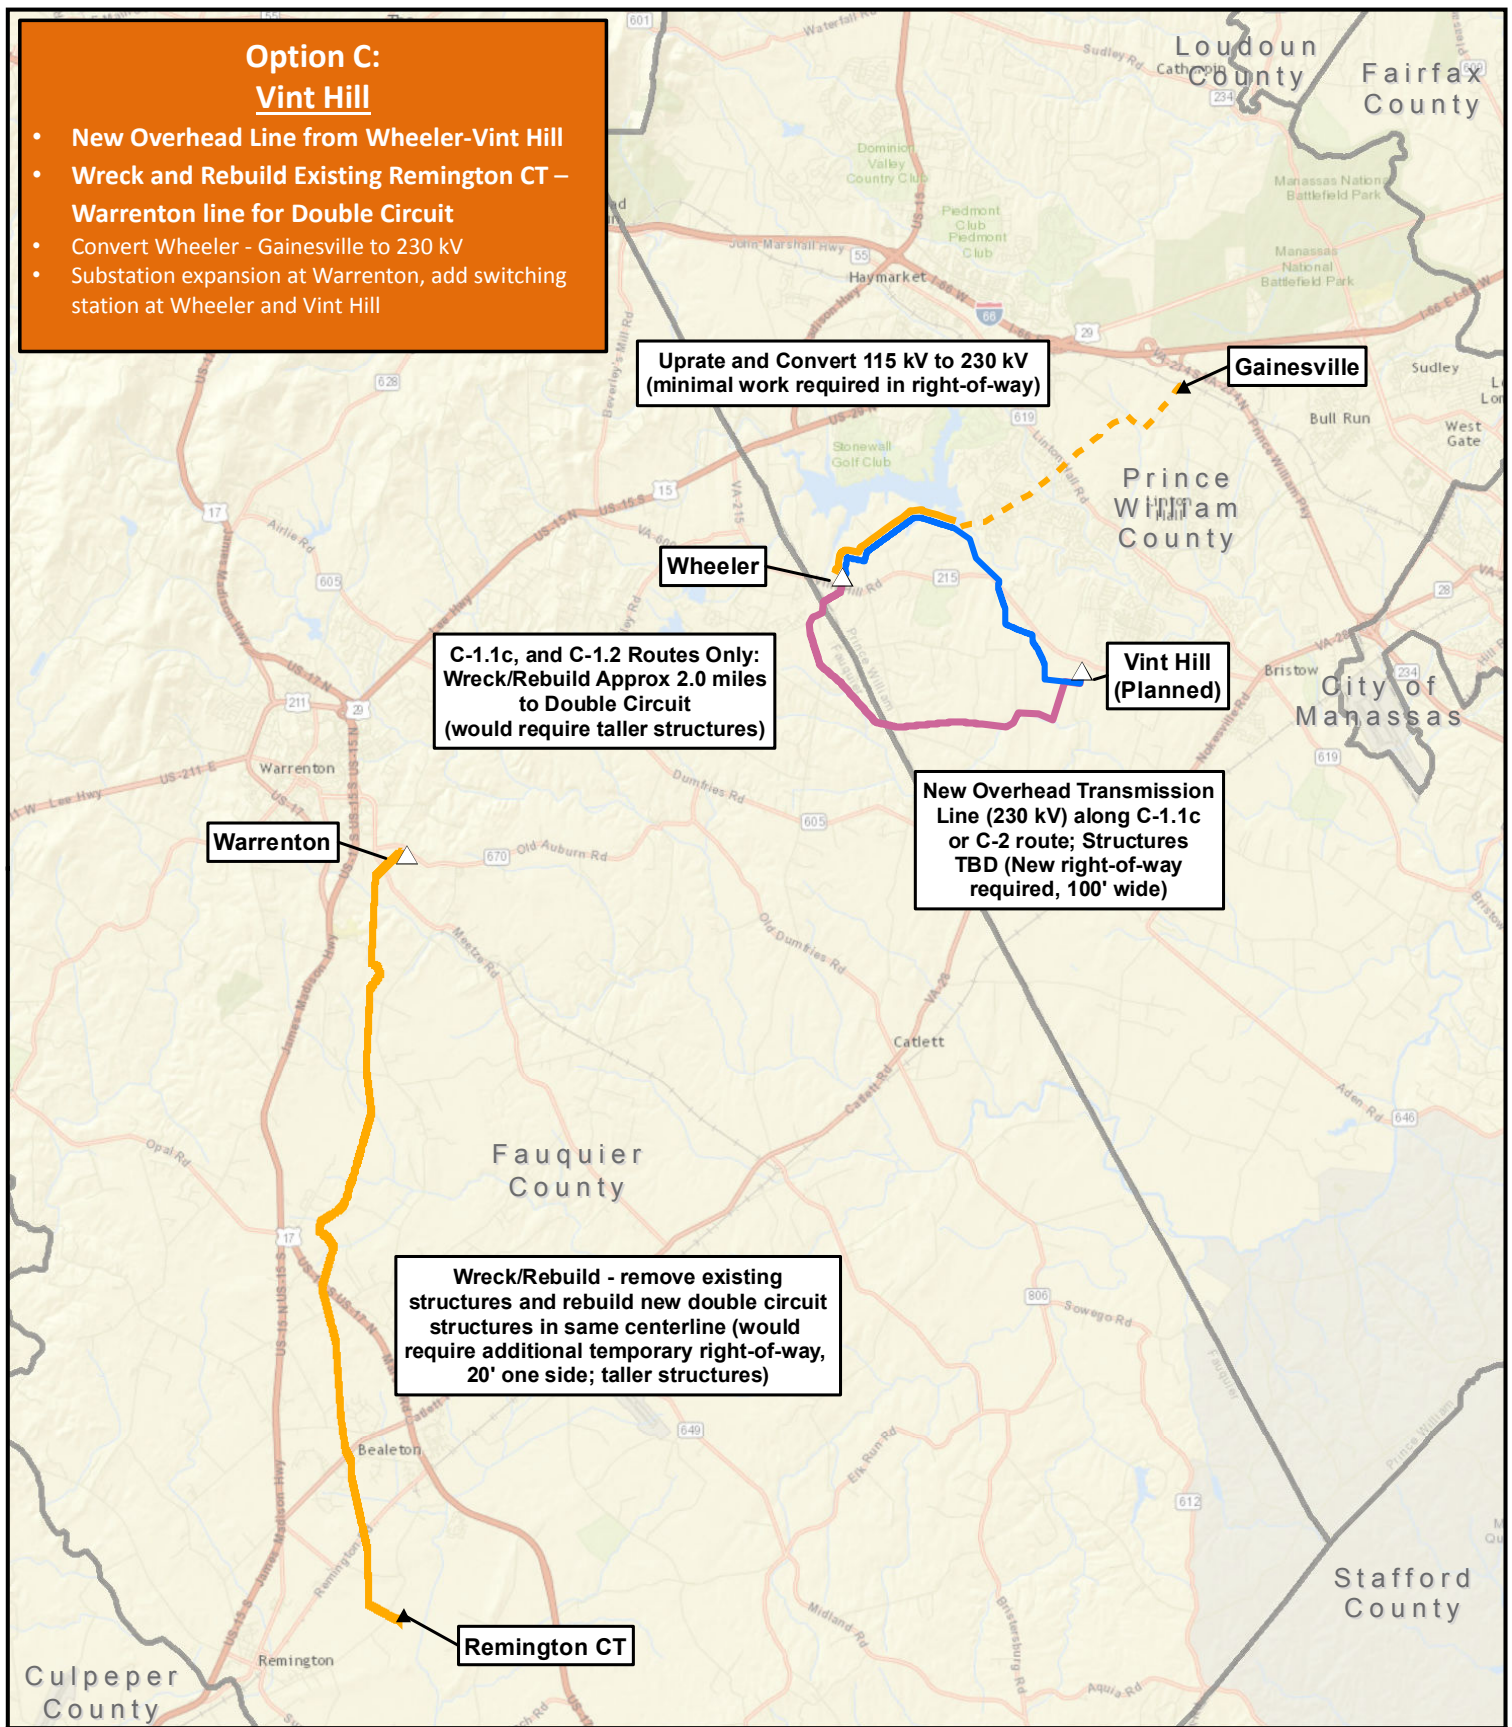