



1

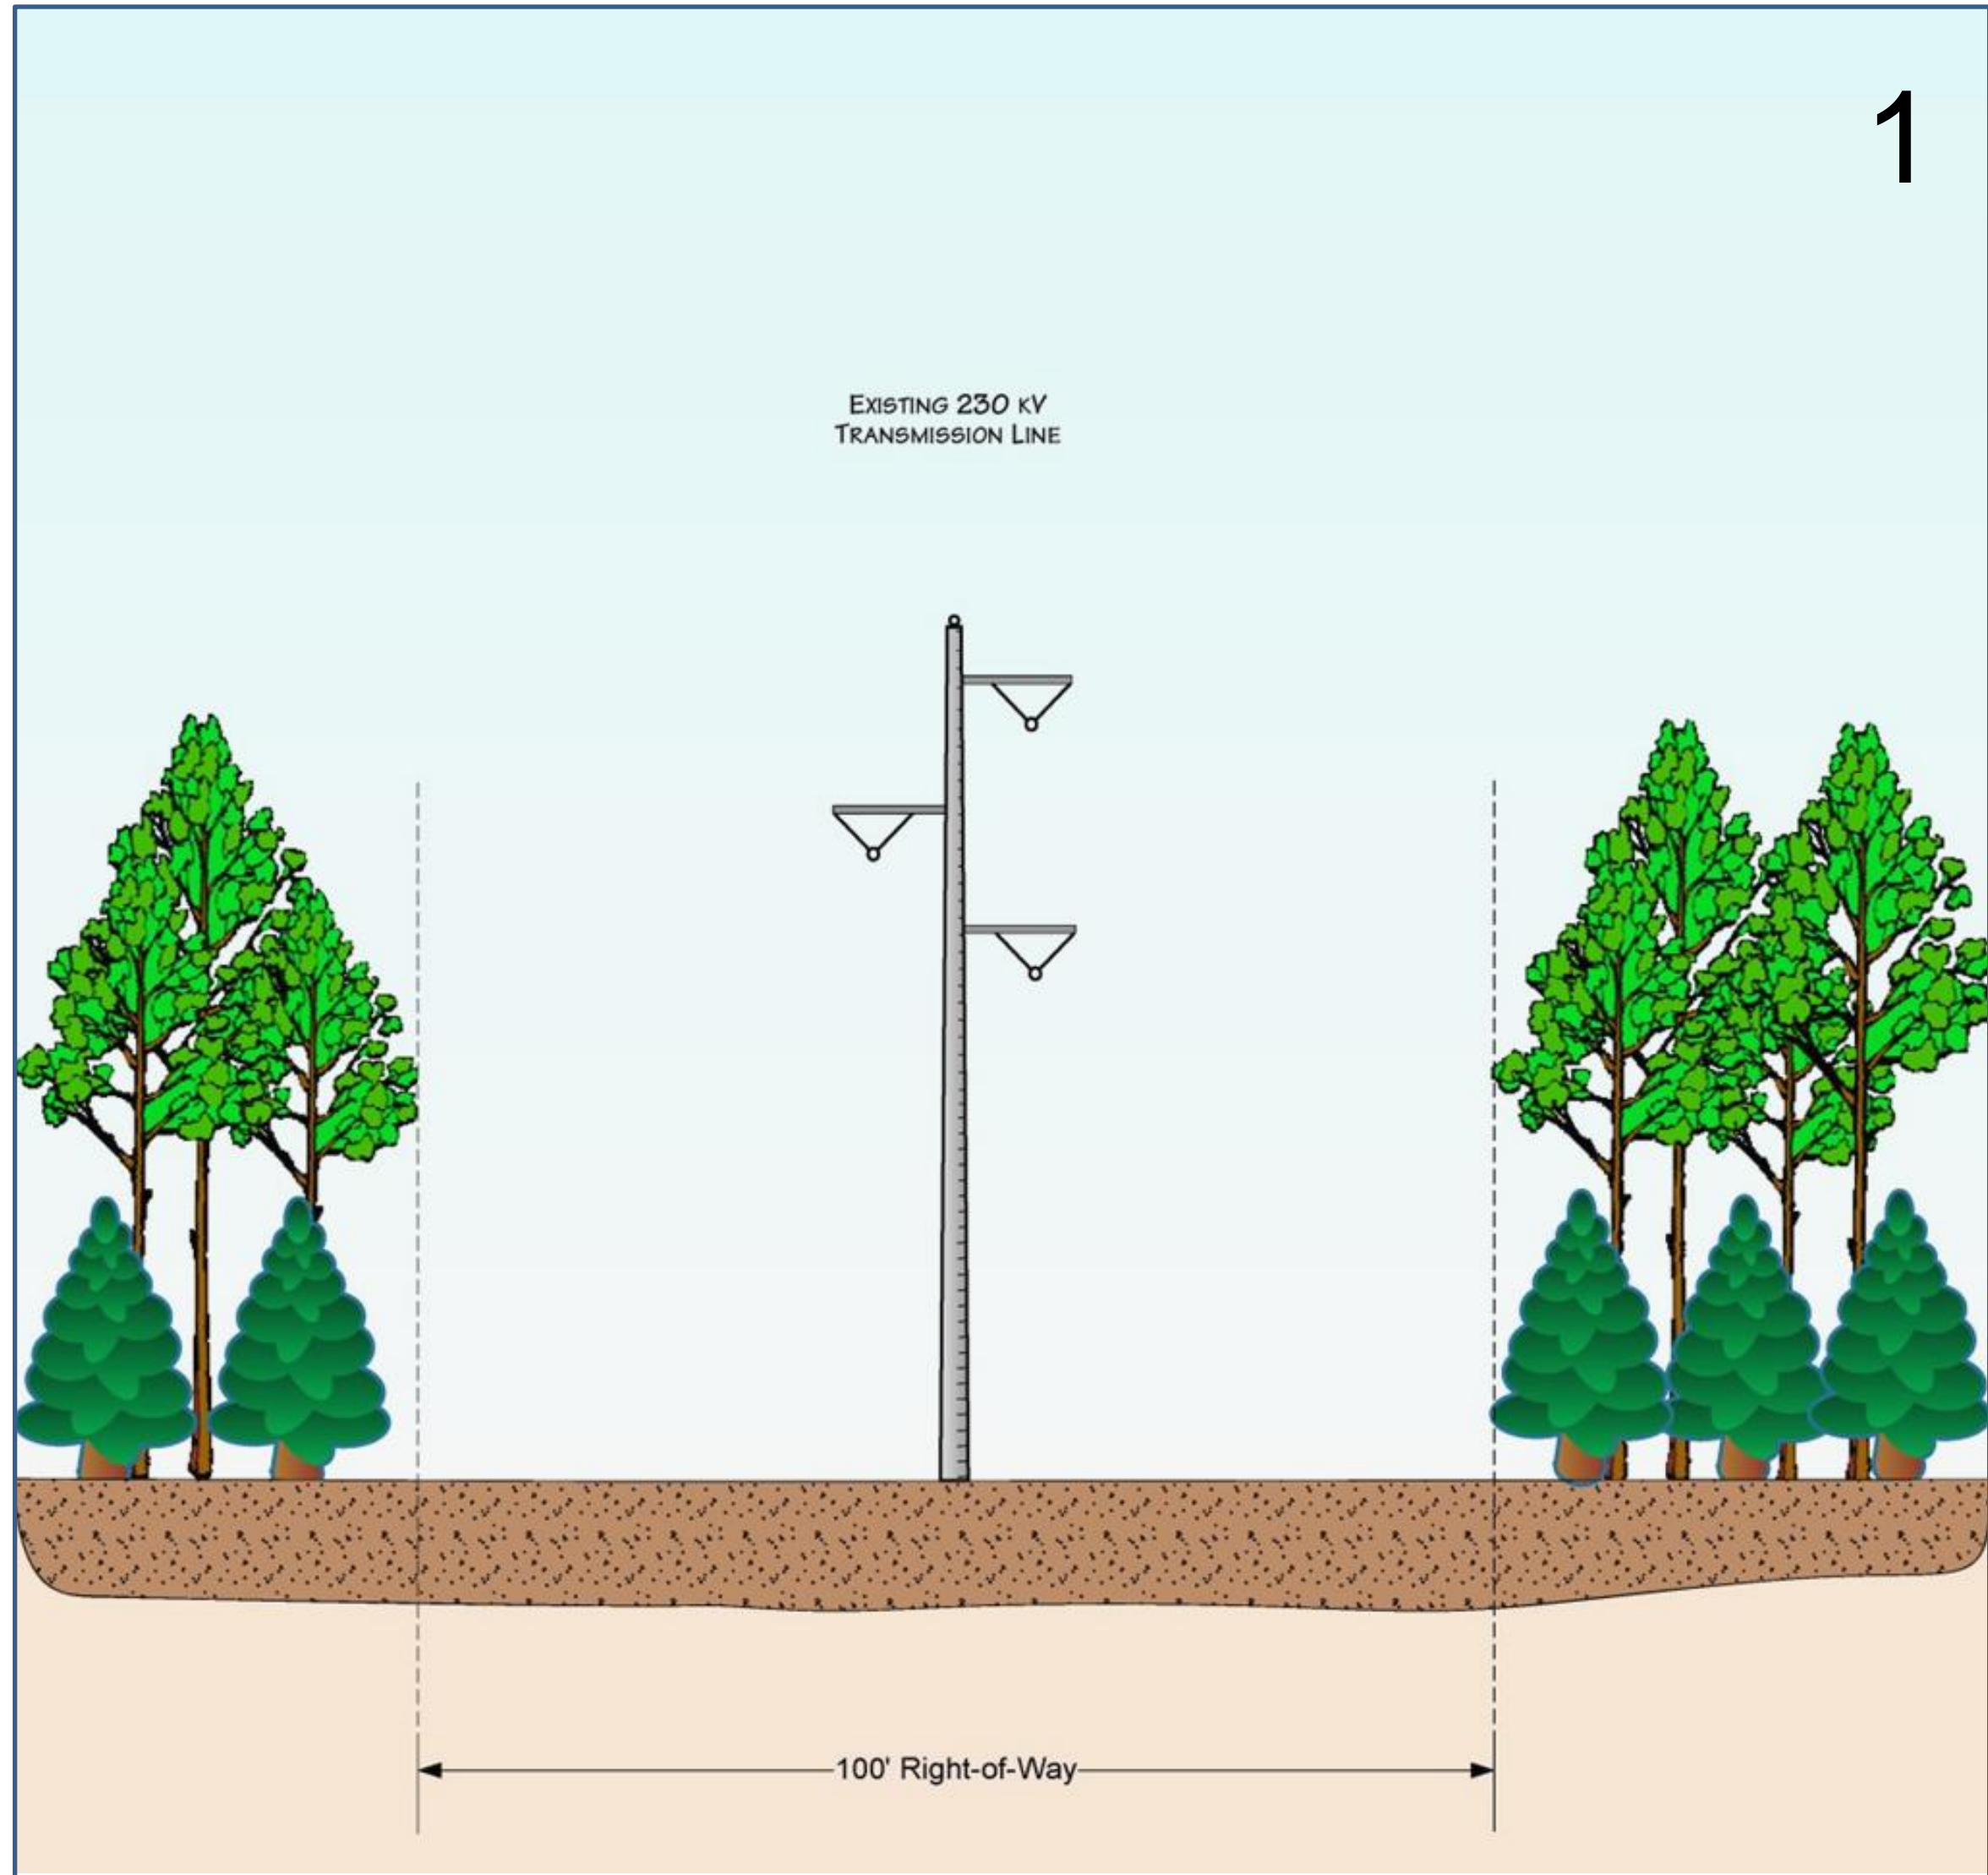


Existing Conditions

2

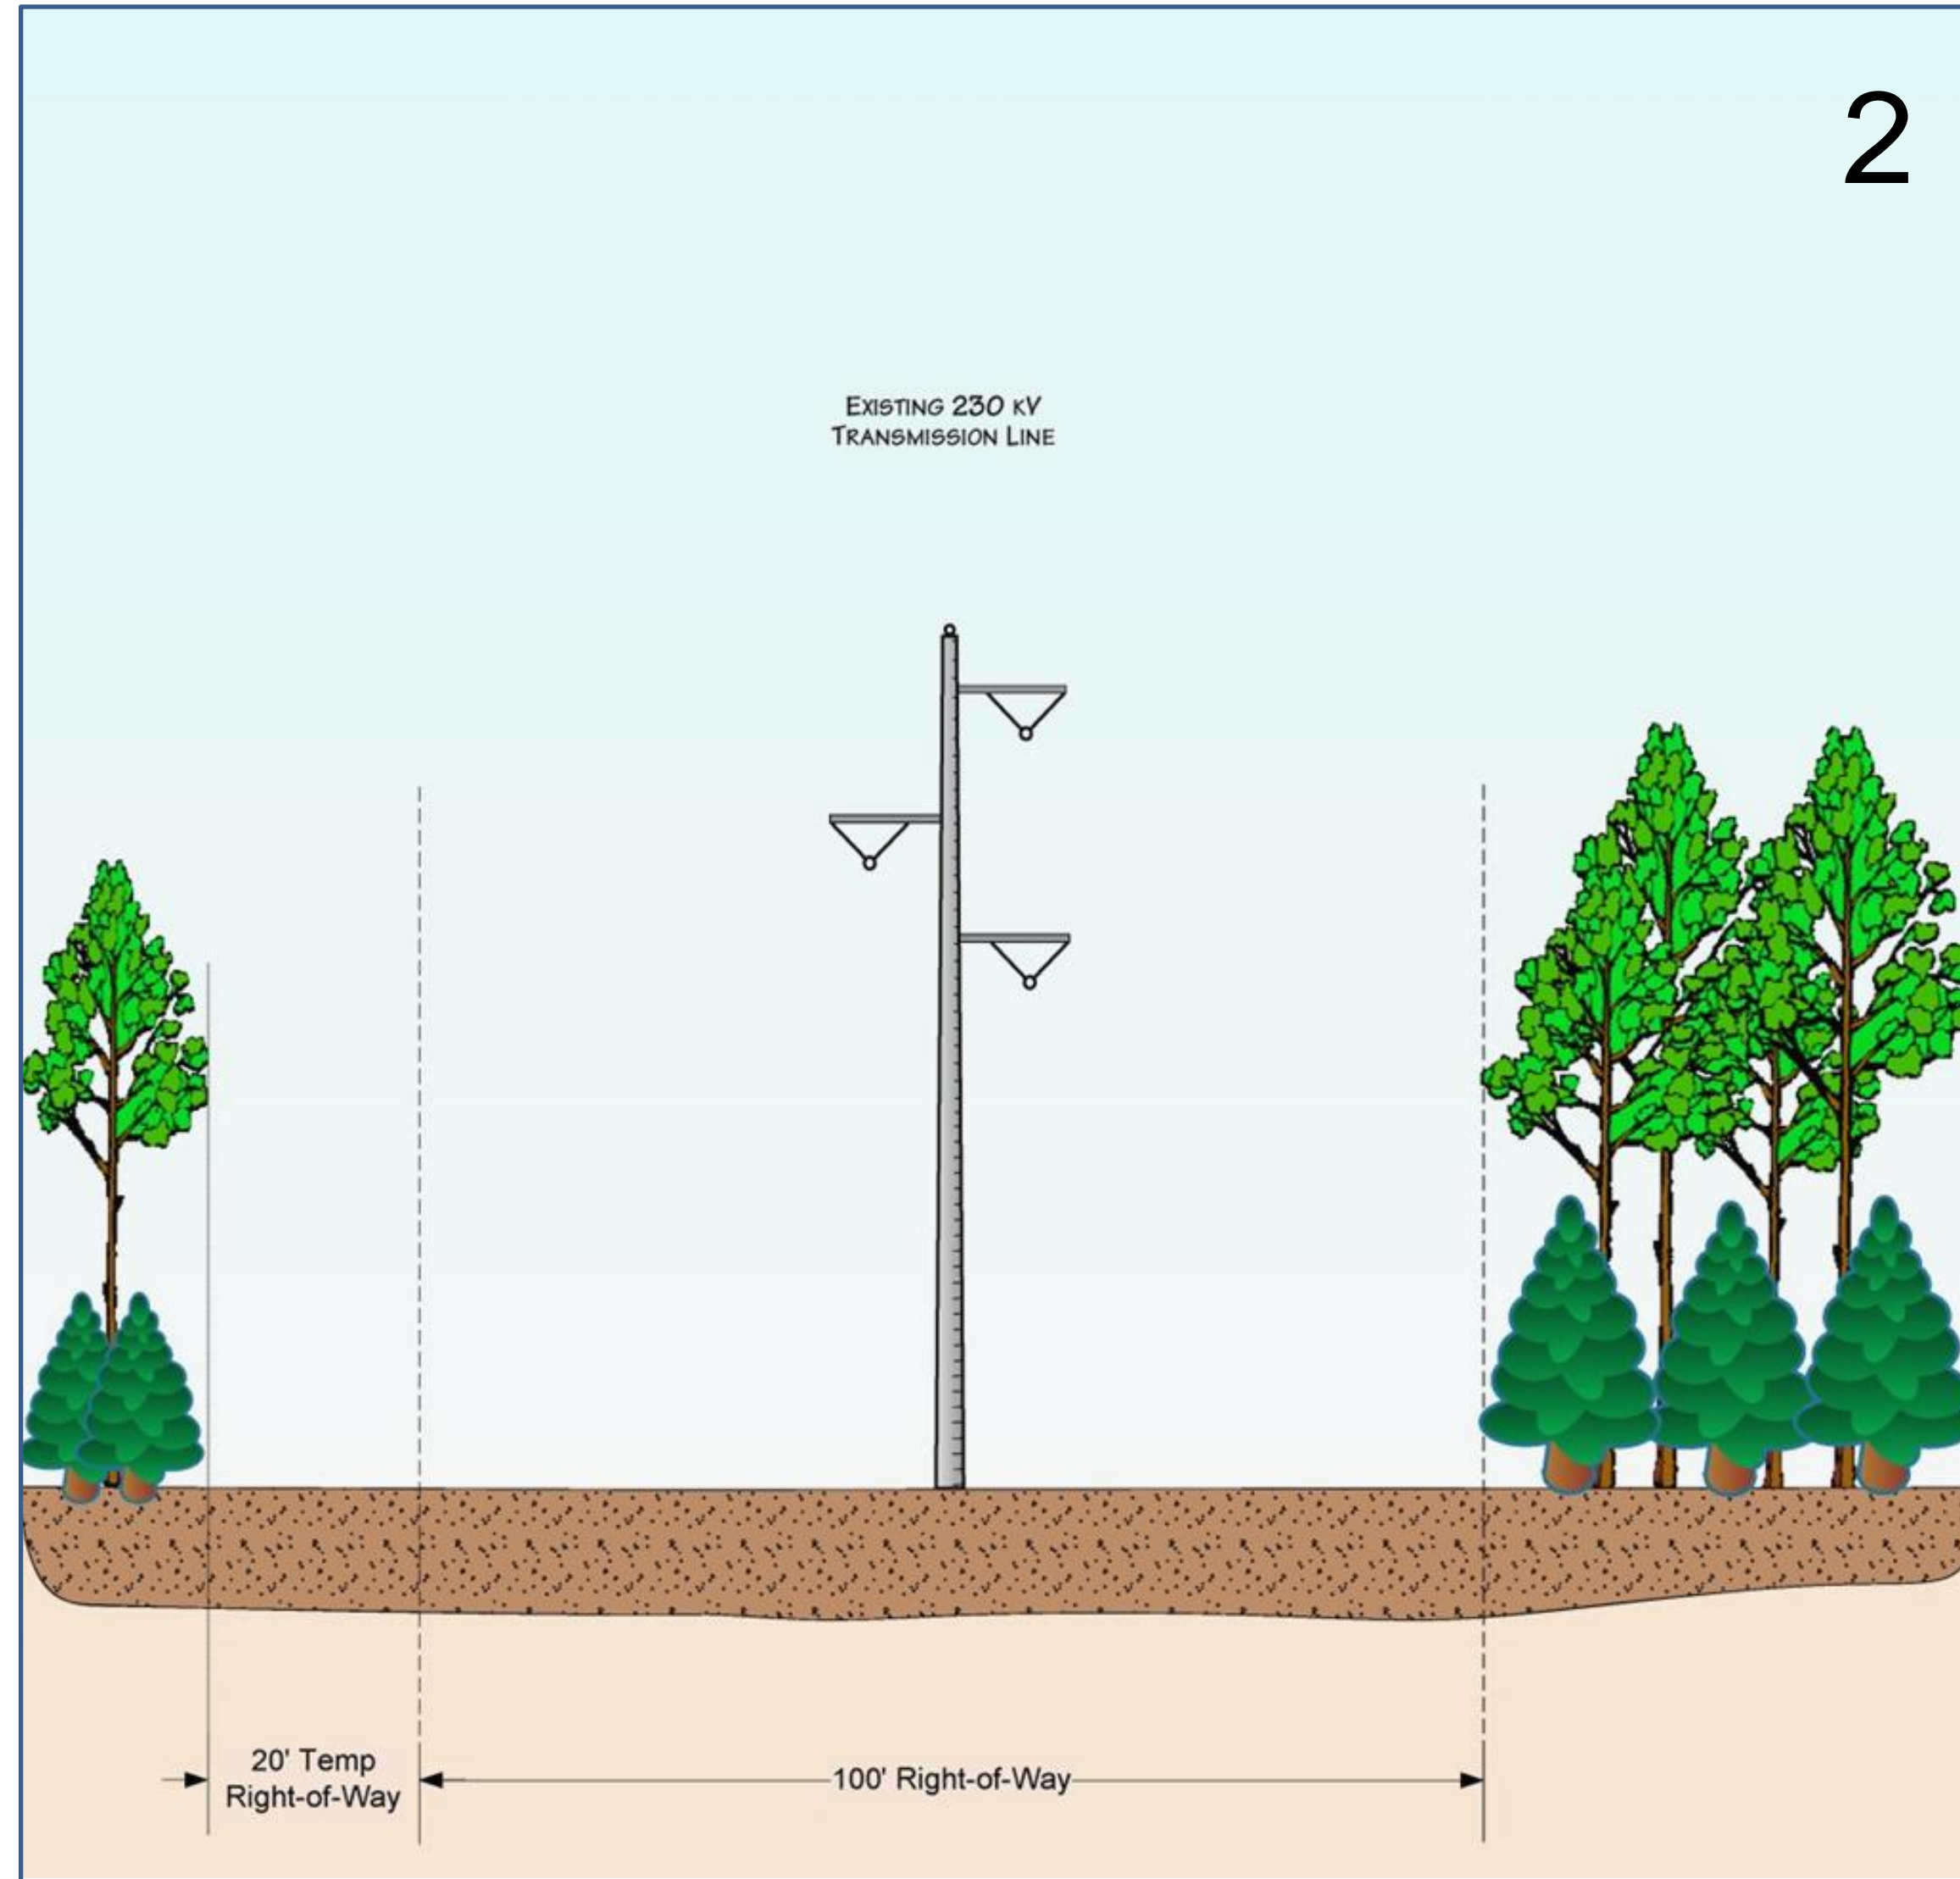

Clear 20 feet of temporary ROW adjacent to existing ROW


3

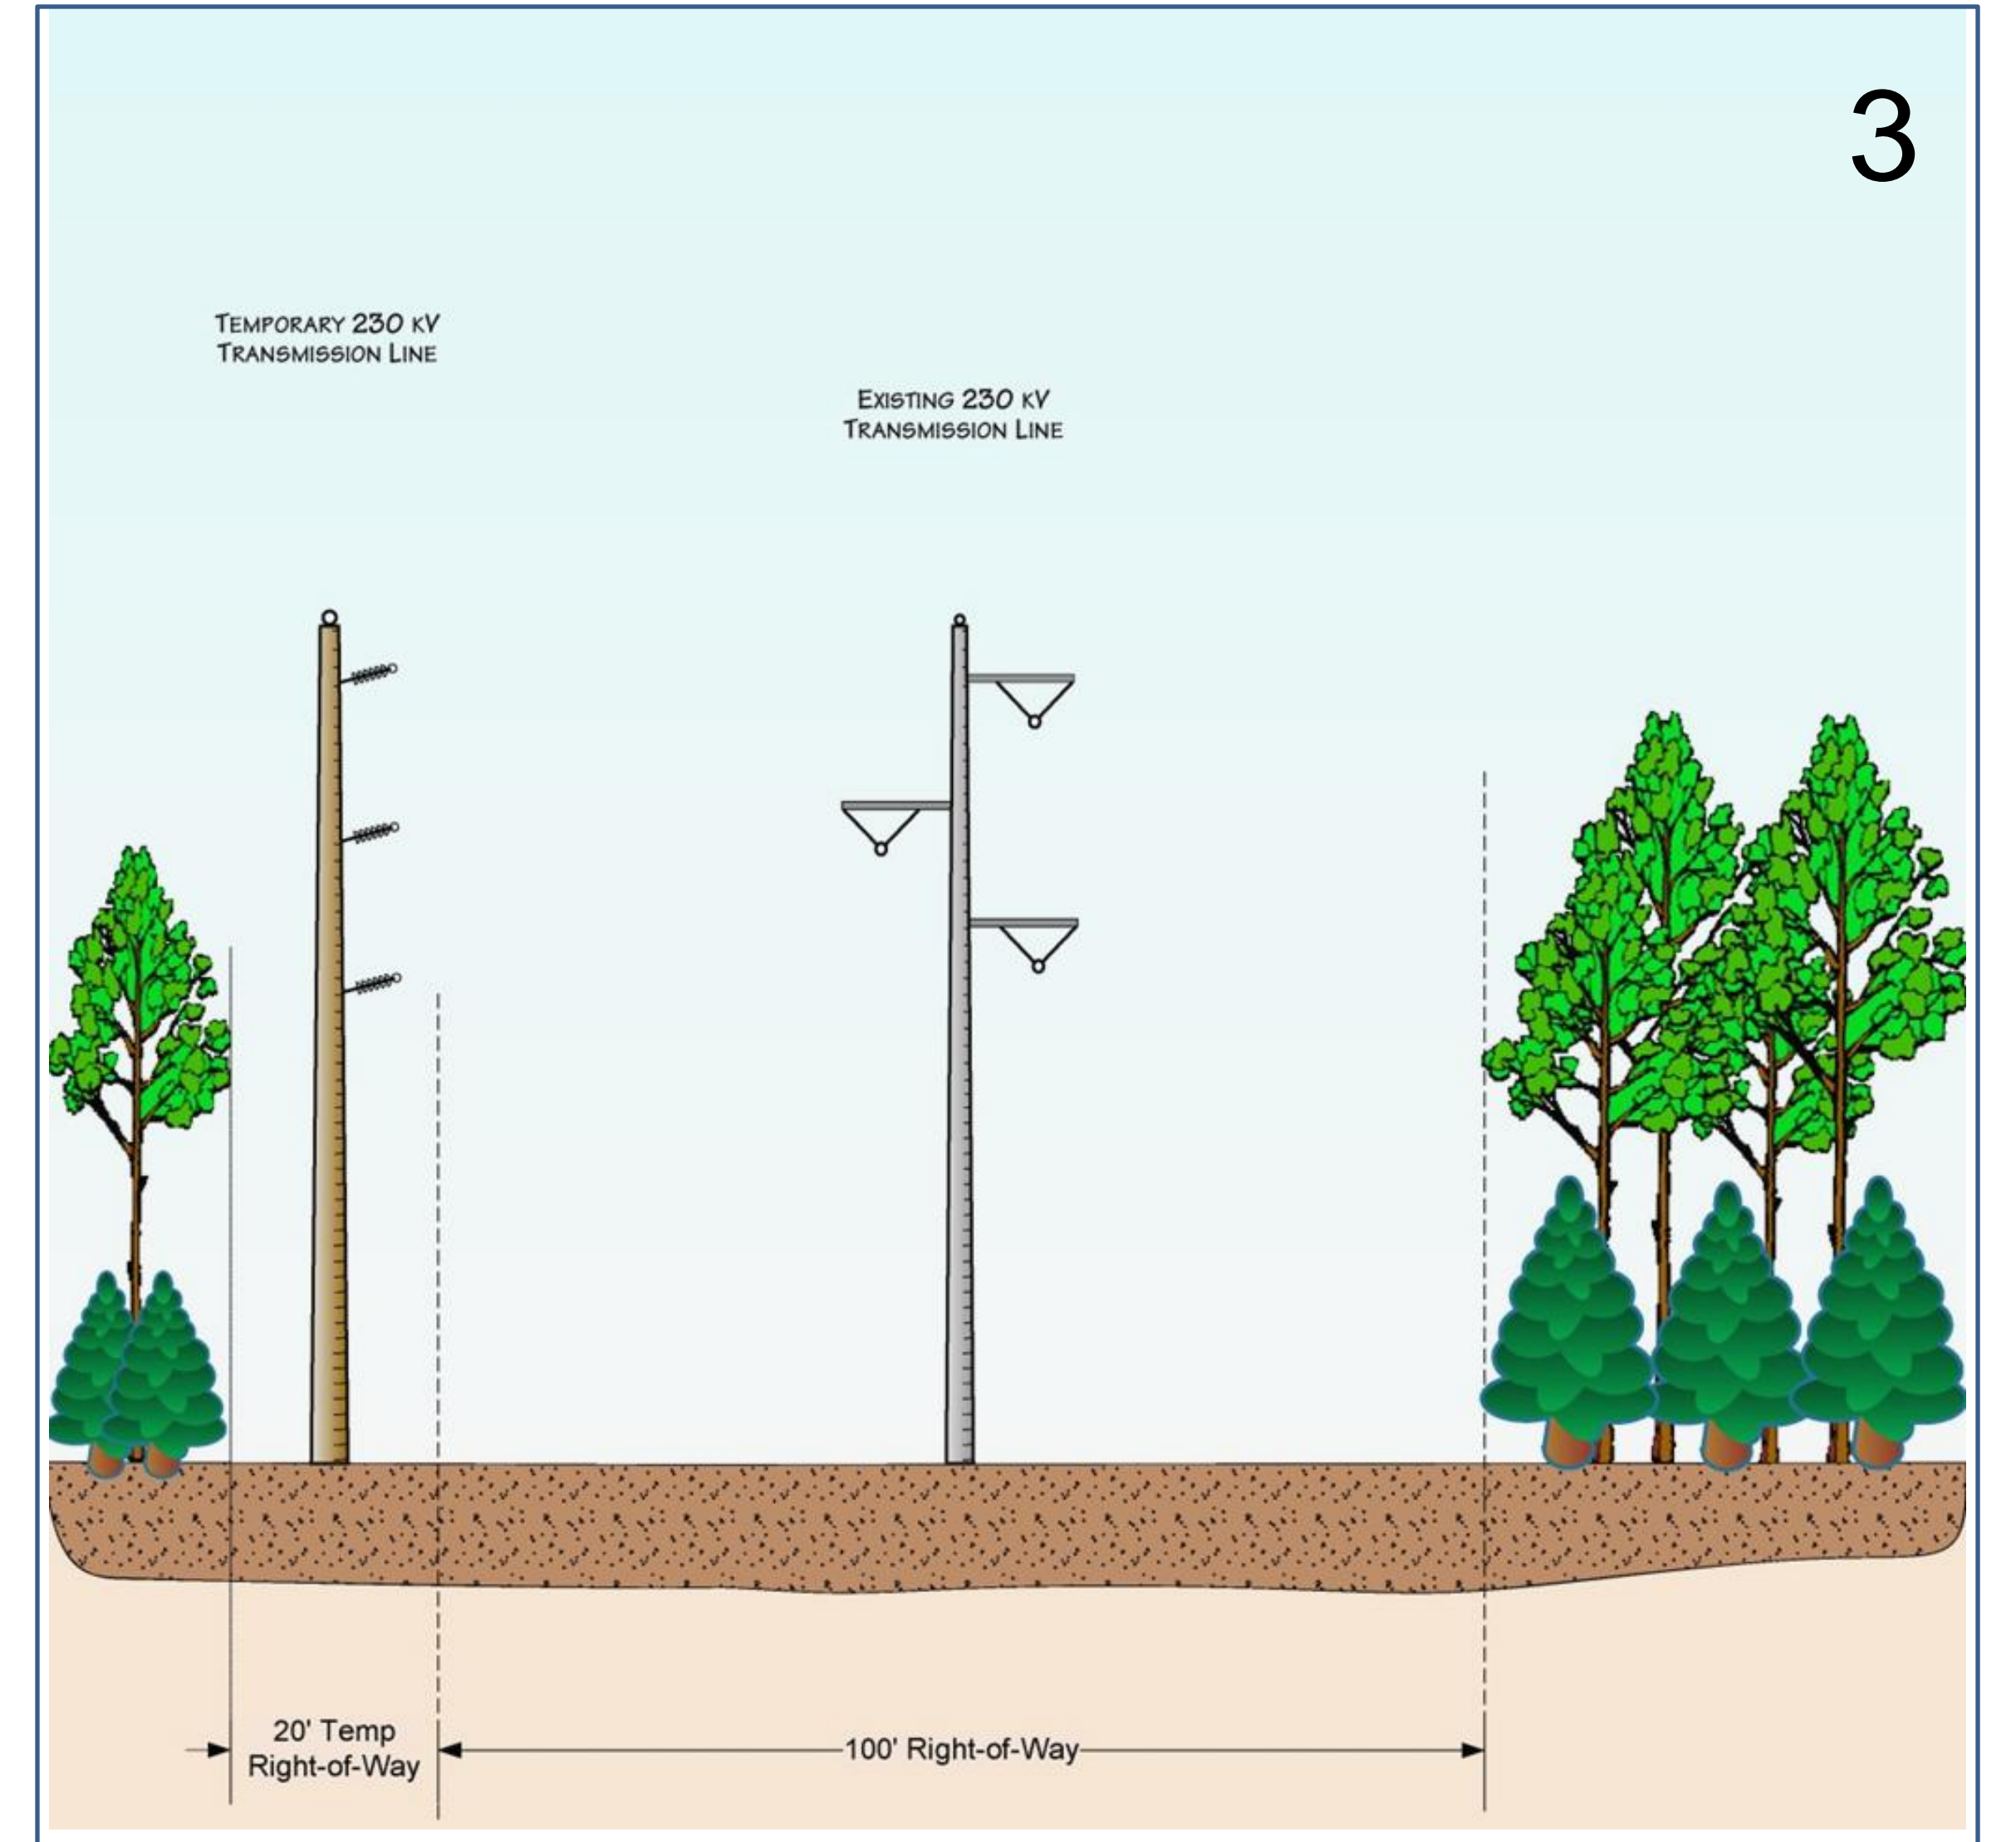

Erect and energize new, temporary 230 kV transmission line adjacent to existing line




4

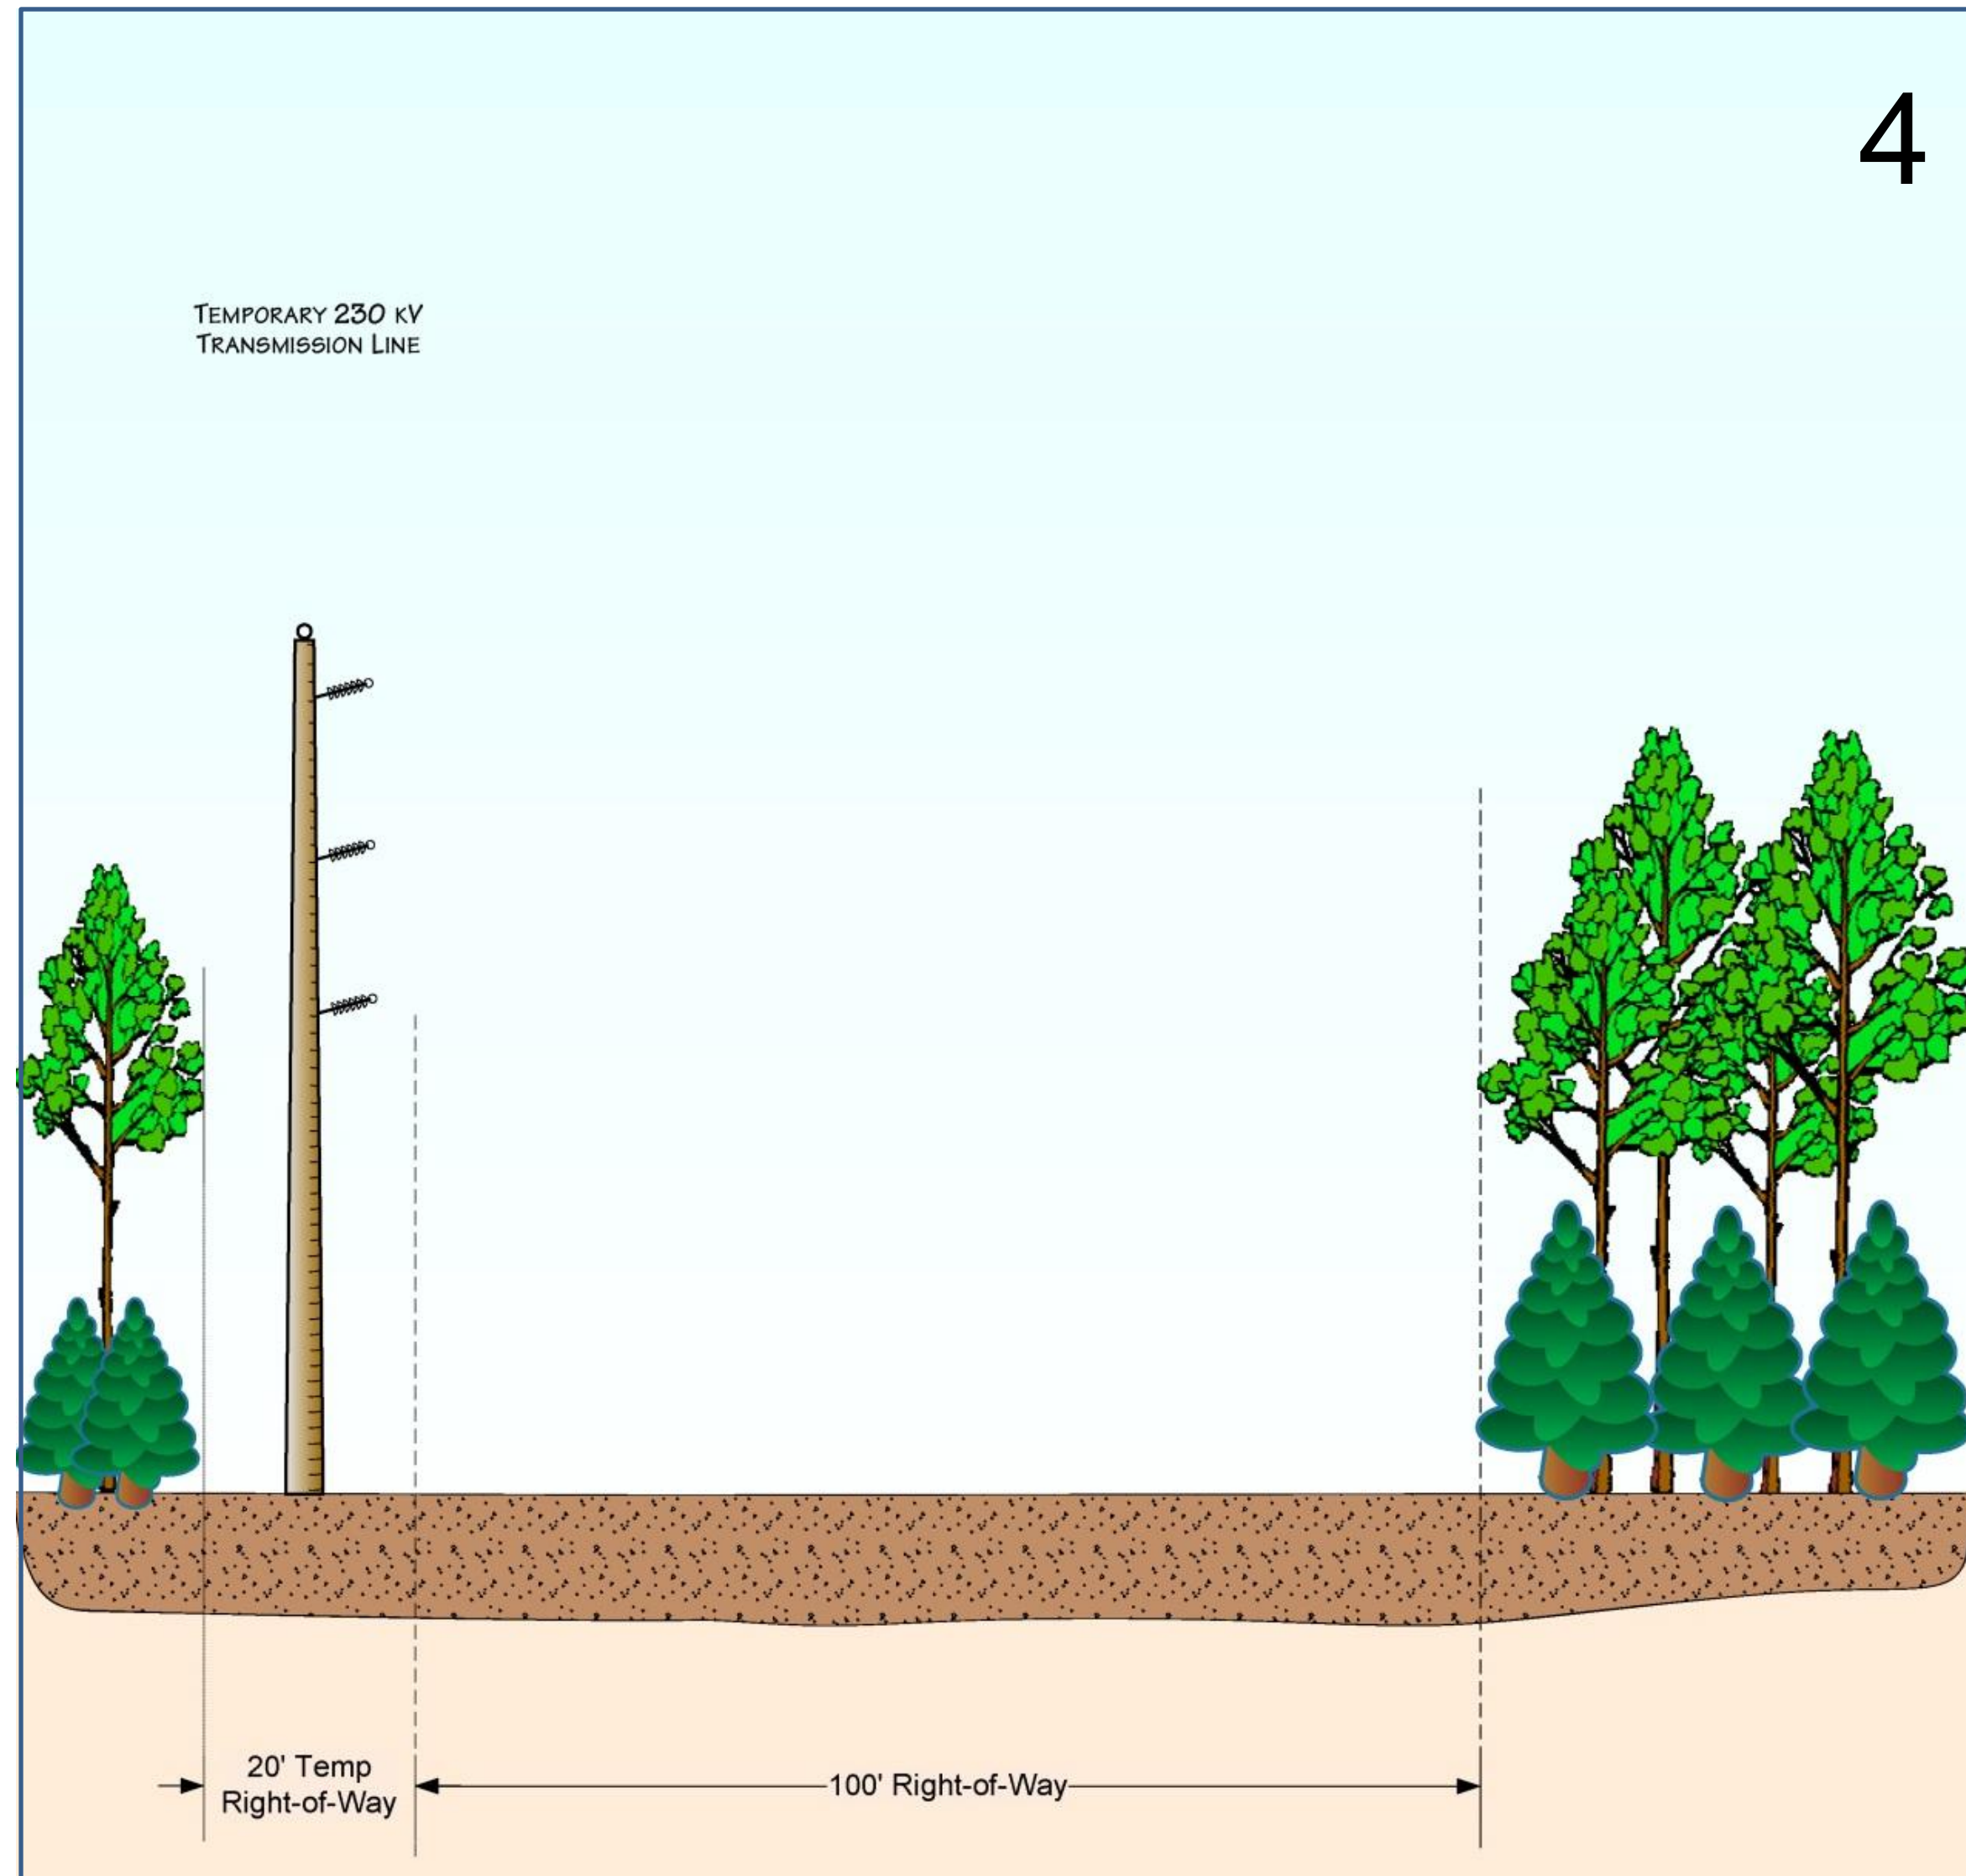


Remove existing transmission line

5

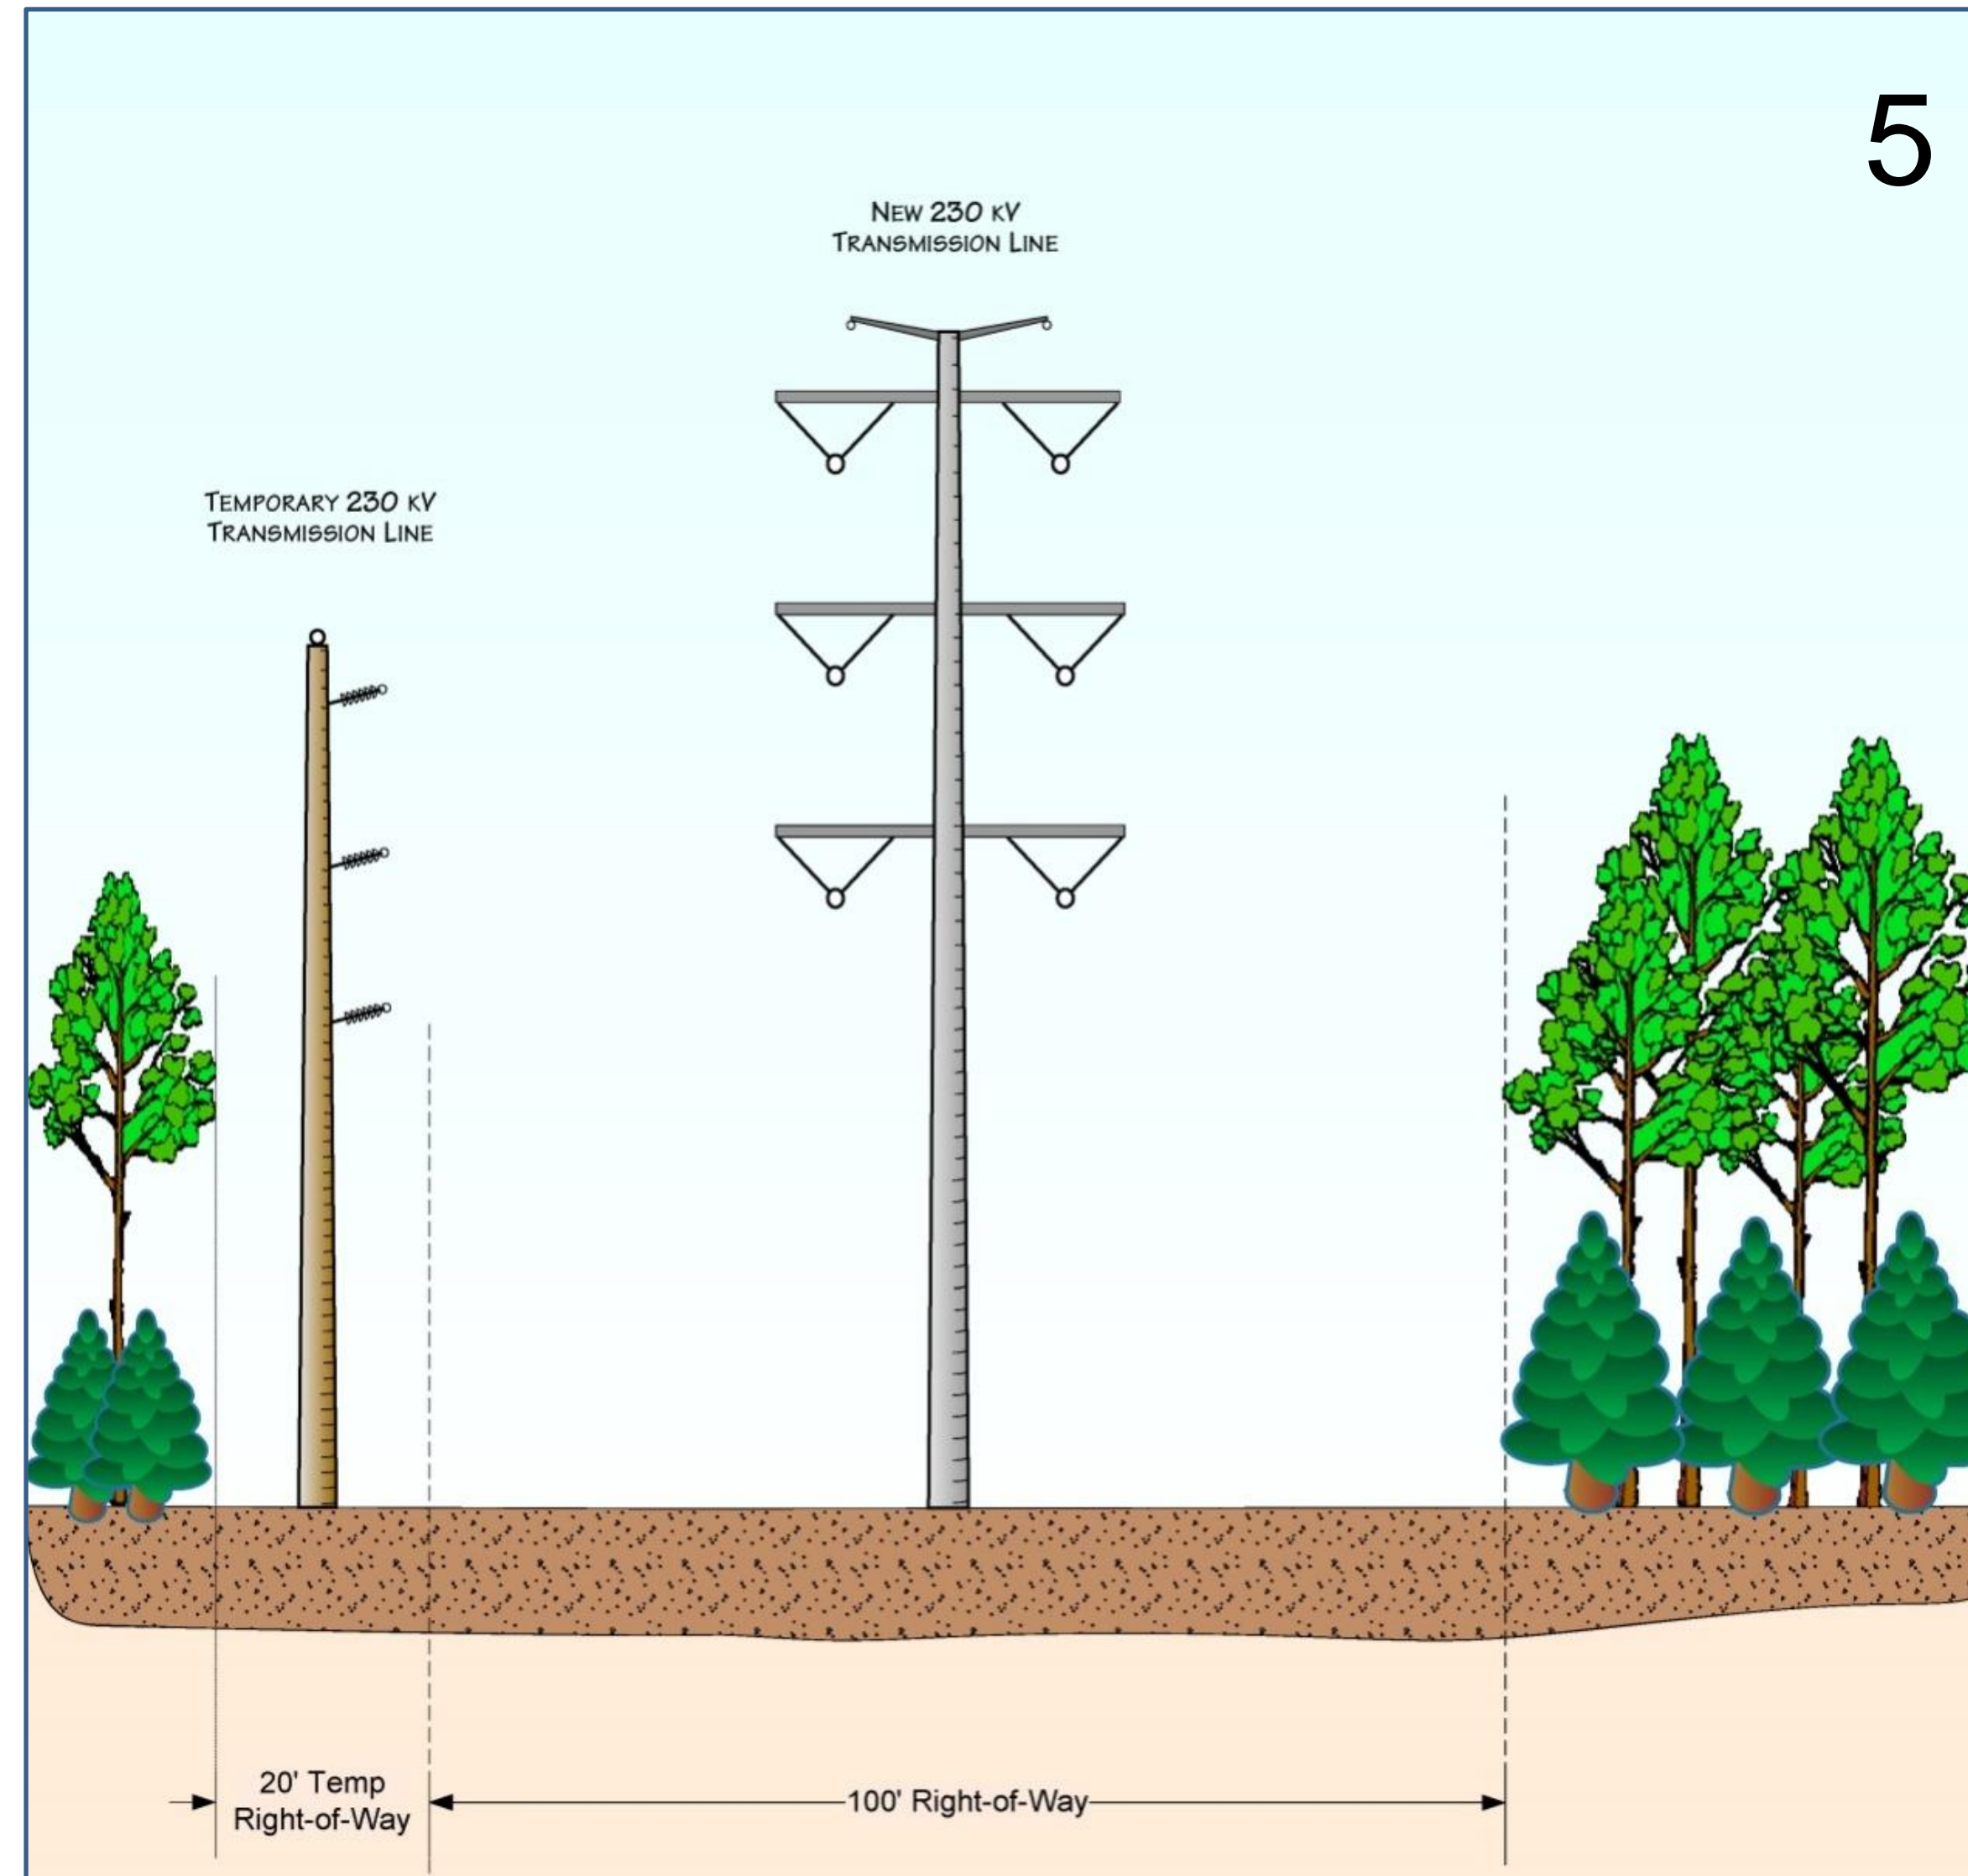

Build new double circuit 230 kV transmission line and energize

6

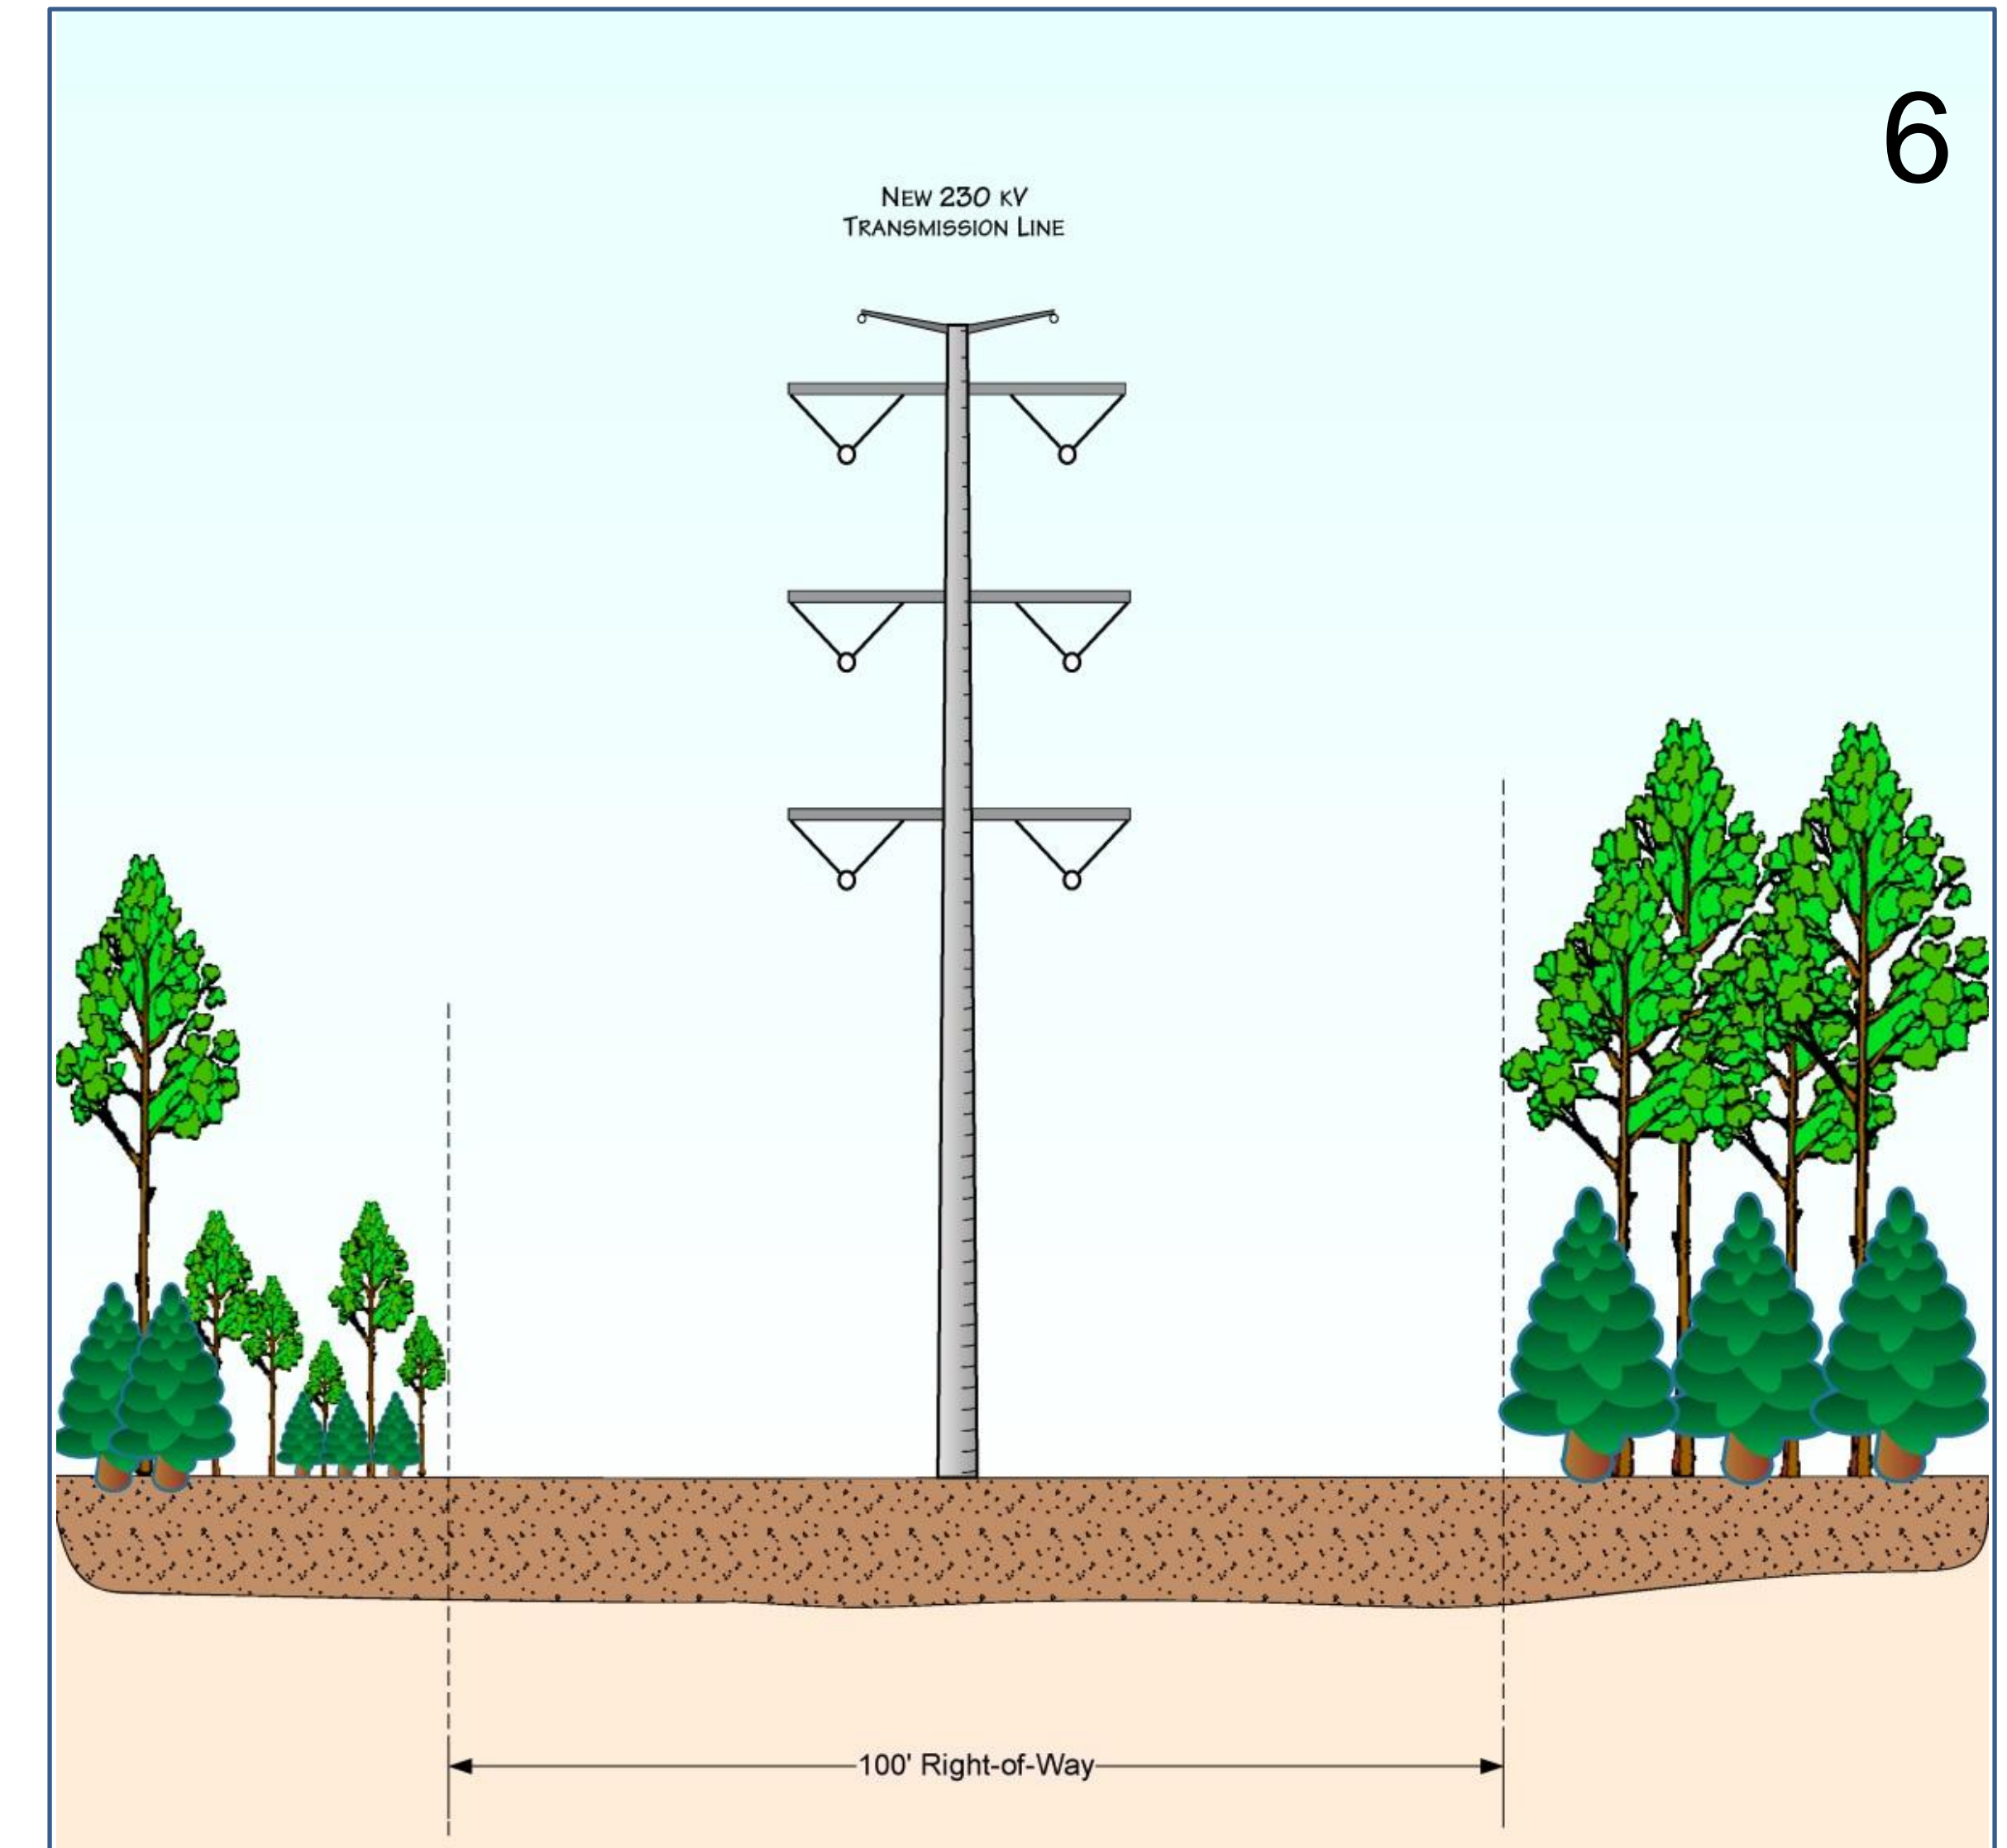

Remove temporary line and restore temporary ROW